


GROUP G

ORIGINAL H-PANEL 2 AMP BATTERY CHARGER WIRING

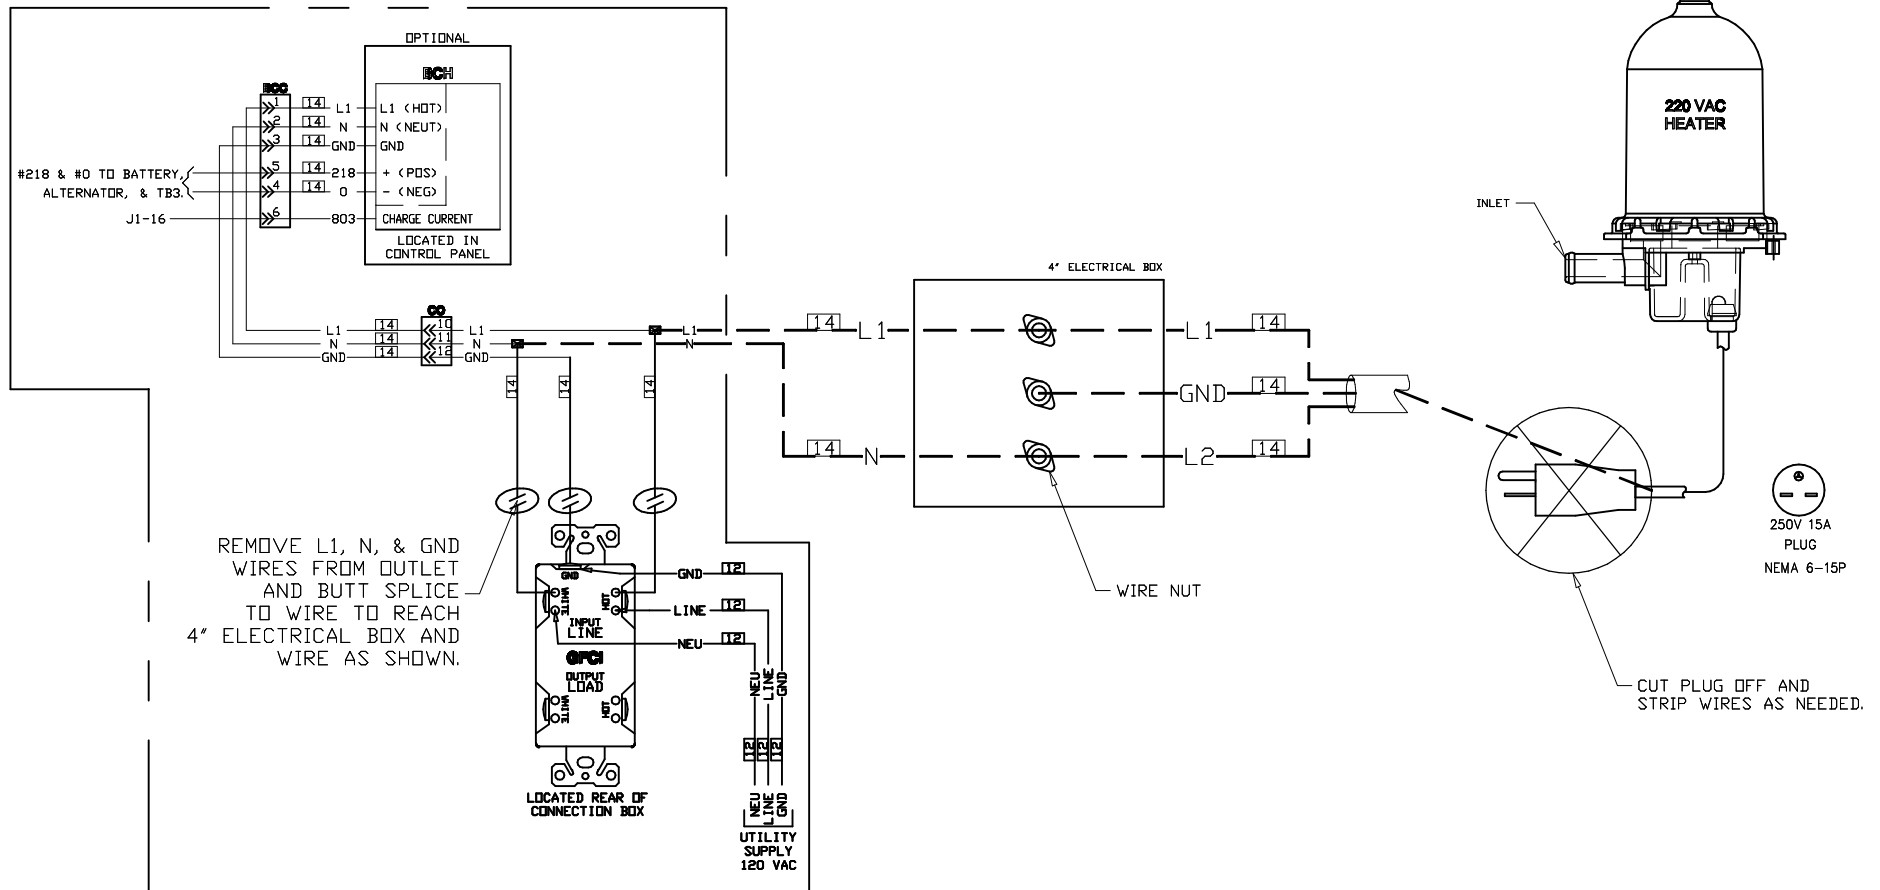

NOTES:

- IF BATTERY CHARGER IS WIRED AS NORMAL TO THE 120VAC RECEPTACLE, REMOVE L1, N, AND GND FROM THE GFCI OUTLET RECEPTACLE LOCATED IN THE 390L CONNECTION BOX.
- IF BATTERY CHARGER IS NOT WIRED TO 120VAC RECEPTACLE, LOCATE WIRES THAT WOULD NORMALLY HAVE RUN TO THE RECEPTACLE AND FOLLOW NEXT INSTRUCTION.
- REROUTE THESE WIRES OUT OF THE RECEPTACLE BOX AND BUTT SPLICE 14 AWG WIRE TO EXTEND THESE WIRES TO THE 4' ELECTRICAL BOX AND WIRE AS SHOWN.
- CUSTOMER TO WIRE UTILITY POWER INTO THE 4' ELECTRICAL BOX AT SITE.